Annual Environmental Report 2024



Milford

D0342-01

CONTENTS

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2024 AER

- 1.1 ANNUAL STATEMENT OF MEASURES
- 1.2 Treatment Summary
- 1.3 ELV OVERVIEW
- 1.4 LICENSE SPECIFIC REPORT INCLUDED IN AER

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

- 2.1 MILFORD (DONEGAL) WWTP TREATED DISCHARGE
 - 2.1.1 INFLUENT SUMMARY MILFORD (DONEGAL) WWTP
 - 2.1.2 EFFLUENT MONITORING SUMMARY MILFORD (DONEGAL) WWTP -
 - 2.1.3 Ambient Monitoring Summary for The Treatment Plant Discharge -
 - 2.1.4 OPERATIONAL REPORTS SUMMARY FOR MILFORD (DONEGAL) WWTP
 - 2.1.5 SLUDGE/OTHER INPUTS TO MILFORD (DONEGAL) WWTP

3 COMPLAINTS AND INCIDENTS

- 3.1 COMPLAINTS SUMMARY
- 3.2 REPORTED INCIDENTS SUMMARY
 - 3.2.1 SUMMARY OF INCIDENTS
 - 3.2.2 Summary of Overall Incidents

4 INFRASTRUCTURAL ASSESSMENT AND PROGRAMME OF IMPROVEMENTS

- 4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT
 - 4.1.1 SWO IDENTIFICATION AND INSPECTION SUMMARY REPORT
- 4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS
 - 4.2.1 Specified Improvement Programme Summary
- 4.2.2 IMPROVEMENT PROGRAMME SUMMARY
- 4.2.3 SEWER INTEGRITY RISK ASSESSMENT

5 LICENCE SPECIFIC REPORTS

- 5.1 PRIORITY SUBSTANCES ASSESSMENT
- 5.2 SMALL STREAM RISK SCORE ASSESSMENT

6 CERTIFICATION AND SIGN OFF

5.1 SUMMARY OF AER CONTENTS

7 APPENDIX

7.1 SMALL STREAM RISK SCORE ASSESSMENT

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2024 AER

This Annual Environmental Report has been prepared for D0342-01, Milford, in Donegal in accordance with the requirements of the wastewater discharge licence for the agglomeration. On December 16th, 2024, a new licence (Ramelton, Milford, Rathmullan (RMR) - D0341-02) was issued combining the agglomerations of Ramelton (D0341-01), Milford (D0342-01), and Rathmullan (D0345-01). Specified reports where relevant are included as an appendix to the AER.

1.1 ANNUAL STATEMENT OF MEASURES

A summary of any improvements undertaken is provided where applicable.

1.2 TREATMENT SUMMARY

The agglomeration is served by a wastewater treatment plant(s)

• Milford (Donegal) WWTP with a Plant Capacity PE of 920, the treatment type is 2 - Secondary treatment .

1.3 ELV OVERVIEW

The overall compliance of the final effluent with the Emission Limit Values (ELVs) is shown below. More detailed information on the below ELV's can be found in Section 2.

Discharge Point Reference	Treatment Plant	Discharge Type	Compliance Status	Parameters failing if relevant
TPEFF0600D0342SW001	Milford (Donegal) WWTP	Treated	Non-Compliant	Ammonia-Total (as N) mg/l BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l ortho-Phosphate (as P) - unspecified mg/l

1.4 LICENCE SPECIFIC REPORTING

Assessment / Report

Small Stream Risk Score Assessment

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

2.1 MILFORD (DONEGAL) WWTP - TREATED DISCHARGE

2.1.1 INFLUENT MONITORING SUMMARY - MILFORD (DONEGAL) WWTP

A summary of influent monitoring for the treatment plant is presented below. This monitoring is primarily undertaken in order to determine the overall efficiency of the plant in removing pollutants from the raw wastewater.

Parameters	Number of Samples	Annual Max	Annual Mean
Ammonia-Total (as N) mg/l	6	47	19
Total Phosphorus (as P) mg/l	6	14	3.67
ortho-Phosphate (as P) - unspecified mg/l	6	13	2.89
BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l	6	318	113
pH pH units	6	7.90	7.48
Total Nitrogen mg/l	6	99	28
Suspended Solids mg/l	6	361	169
COD-Cr mg/l	6	1110	283
Hydraulic Capacity	N/A	2831	1788

If other inputs in the form of sludge / leachate are added to the WWTP then these are included in Section 2.1.5 if applicable.

Significance of Results:

The annual mean hydraulic loading is greater than the peak Treatment Plant Capacity. The annual maximum hydraulic loading is greater than the peak Treatment Plant Capacity. Further details on the plant capacity and efficiency can be found under the sectional 'Operational Performance Summary'.

2.1.2 EFFLUENT MONITORING SUMMARY - TPEFF0600D0342SW001

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
COD-Cr mg/l	125	250	N/A	6	N/A	N/A	36	Pass
Suspended Solids mg/l	25	62.5	N/A	6	1	N/A	11	Pass
BOD, 5 days with Inhibition (Carbonaceous BOD) mg/l	10	20	N/A	6	2	2	10	Fail
pH pH units	9	9	N/A	6	N/A	N/A	7.33	Pass
Ammonia-Total (as N) mg/l	0.65	1.3	N/A	6	5	4	6.84	Fail
ortho-Phosphate (as P) - unspecified mg/l	0.34	0.68	N/A	6	6	3	0.733	Fail
Total Nitrogen mg/l	N/A	N/A	N/A	6	N/A	N/A	11	

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
Conductivity @20°C µS/cm	N/A	N/A	N/A	6	N/A	N/A	489	
Total Phosphorus (as P) mg/l	N/A	N/A	N/A	6	N/A	N/A	1.20	

Notes:

- 1 This represents the Emission Limit Values after the Interpretation provided for under Condition 2 of the licence is applied
- 2 For pH the WWDA specifies a range of pH 6 9

Cause of Exceedance(s):

Refer to Incident Section of the Report

Significance of Results:

The WWTP is non compliant with the ELVs set in the Wastewater Discharge License. The impact on receiving waters is assessed further in Section 2.

2.1.3 AMBIENT MONITORING SUMMARY FOR THE TREATMENT PLANT DISCHARGE TPEFF0600D0342SW001

A summary of monitoring from ambient monitoring points associated with the wastewater discharge is provided in the sections below. For discharges to rivers upstream (U/S) and downstream (D/S) location data is provided. For other ambient points in lakes, coastal or transitional waters, monitoring data from the most appropriate monitoring station is selected.

The table below provides details of ambient monitoring locations and details of any designations as sensitive areas.

Ambient Monitoring Point from WWDL (or as agreed with EPA)	Irish Grid Reference	River Station Code	Bathing Water	Drinking Water	FWPM	Shellfish	WFD Ecological Status
Upstream	219277, 426509	RS39M010150	No	No	No	No	Poor
Downstream	218606, 424918	RS39M010300	No	No	No	No	Poor

The table below provides a summary of monitoring results for designated ambient monitoring points. The upstream and downstream annual mean values are shown (mg/l), and the difference between both monitoring stations is given as a percentage of the Environmental Quality Standard (EQS) where relevant.

Parameter Name	Upstream Monitoring Point Location	Upstream Monitoring Point Annual Mean	Downstream Monitoring Point Location	Downstream Monitoring Point Annual Mean	EQS	% of EQS
BOD - 5 days (Total) mg/l	RS39M010150	1.54	RS39M010300	1.90	1.50	23.9
Ammonia-Total (as N) mg/l	RS39M010150	0.074	RS39M010300	0.248	0.065	266.6
ortho-Phosphate (as P) - unspecified mg/l	RS39M010150	0.040	RS39M010300	0.046	0.035	16.7
pH pH units	RS39M010150	7.76	RS39M010300	7.22	N/A	
Total Nitrogen mg/l	RS39M010150	0.846	RS39M010300	1.10	N/A	
Total Phosphorus (as P) mg/l	RS39M010150	0.052	RS39M010300	0.096	N/A	
Dissolved Oxygen % Saturation	RS39M010150	94	RS39M010300	72	N/A	
Suspended Solids mg/l	RS39M010150	5.15	RS39M010300	6.85	N/A	

Parameter Name	Upstream Monitoring Point Location	Upstream Monitoring Point Annual Mean	Downstream Monitoring Point Location	Downstream Monitoring Point Annual Mean	EQS	% of EQS
Conductivity @20°C µS/cm	RS39M010150	281	RS39M010300	265	N/A	
Temperature °C	RS39M010150	9.82	RS39M010300	9.48	N/A	

Significance of Results:

The coastal/transitional ambient monitoring results do not meet the required EQS. The EQS relates to the Oxygenation and Nutrient Conditions set out in the Surface Water Regulations 2009.

The WWTP discharge was not compliant with the ELV's set in the wastewater discharge licence.

The ambient monitoring results do not meet the required EQS at the upstream and the downstream monitoring locations. The EQS relates to the Oxygenation and Nutrient Conditions set out in the Surface Water Regulations 2009.

Based on ambient monitoring results a deterioration in Ammonia (as N) mg/l, BOD5 (Total) mg/l, and Orthophosphate (as P) mg/l., concentrations downstream of the effluent discharge is noted.

A deterioration in water quality has been identified, however it is not known if it or is not caused by the WWTP.

Other causes of deterioration in water quality in the area are unknown.

The discharge from the wastewater treatment plant does have an observable negative impact on the Water Framework Directive status.

2.1.4 OPERATIONAL PERFORMANCE SUMMARY - MILFORD (DONEGAL) WWTP

2.1.4.1 Treatment Efficiency Report - Milford (Donegal) WWTP

Treatment efficiency is based on the removal of key pollutants from the influent wastewater by the treatment plant. In essence the calculation is based on the balance of load coming into the plant versus the load leaving the plant. The efficiency is presented as a percentage removal rate.

A summary presentation of the efficiency of the treatment process including information for all the parameters specified in the licence is included below:

Parameter	Influent mass loading (kg/year)	Effluent mass emission (kg/year)	Efficiency (% reduction of influent load)
ss	110238	7255	93
ТР	2396	785	67
cBOD	73461	6587	91
TN	18530	7307	61
COD	184789	23377	87

Note: The above data is based on sample results for the number of dates reported

2.1.4.2 Treatment Capacity Report Summary - Milford (Donegal) WWTP

Treatment capacity is an assessment of the hydraulic (flow) and organic (the amount of pollutants) load a treatment plant is designed to treat versus the current loading of that plant.

Milford (Donegal) WWTP					
Peak Hydraulic Capacity (m³/day) - As Constructed					
DWF to the Treatment Plant (m³/day)	207				
Current Hydraulic Loading - annual max (m³/day)	2831				
Average Hydraulic loading to the Treatment Plant (m³/day)					
Organic Capacity (PE) - As Constructed					
Organic Capacity (PE) - Collected Load (peak week)Note1					
Organic Capacity (PE) - Remaining					
Will the capacity be exceeded in the next three years? (Yes/No)	Yes				

Nominal design capacities can be based on conservative design principles. In some cases assessment of existing plants has shown organic capacities significantly higher than the nominal design capacity. Accordingly plants that appear to be overloaded when comparing a collected peak load with the nominal design capacity can be fully compliant due to the safety factors in the original design.

2.1.5 SLUDGE / OTHER INPUTS - MILFORD (DONEGAL) WWTP

'Other inputs' to the waste water treatment plant are summarised in table below

Input type	Quantity	Unit	P.E.	% of load to WWTP	Included in Influent Monitoring (Y/N)?	Is there a leachate/sludge acceptance procedure for the WWTP?	Is there a dedicated leachate/sludge acceptance facility for the WWTP? (Y/N)		
There is	There is no Sludge and Other Input data for the Treatment Plant included in the AER.								

3 COMPLAINTS AND INCIDENTS

3.1 COMPLAINTS SUMMARY

A summary of complaints of an environmental nature related to the discharge(s) to water from the WWTP and network is included below.

Number of Complaints	Nature of Complaint	Number Open Complaints	Number Closed Complaints					
There were no relevant environment	There were no relevant environmental complaints in 2024.							

3.2 REPORTED INCIDENTS SUMMARY

Environmental incidents that arise in an agglomeration are reported on an on-going basis in accordance with our waste water discharge licences. Where an incident occurs and it is reportable under the licence, it is reported to the Environmental Protection Agency through their Environmental Data Exchange Network, or in some instances by telephone. Some incidents which arise in the agglomeration are recorded by Uisce Éireann but may not be reportable under our licence for example where the incident does not have an impact on environmental performance.

A summary of reported incidents is included below.

3.2.1 SUMMARY OF INCIDENTS

Incident Type	Incident Type Cause		Closed (Y/N)
Breach of ELV	Breach of ELV WWTP operating above capacity		No

3.2.2 SUMMARY OF OVERALL INCIDENTS

Question	Answer
Number of Incidents in 2024	1
Number of Incidents reported to the EPA via EDEN in 2024	1
Explanation of any discrepancies between the two numbers above	N/A

4 INFRASTRUCTURAL ASSESSMENTS AND PROGRAMME OF IMPROVEMENTS

4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT

A summary of the operation of the storm water overflows and their significance where known is included below:

4.1.1 SWO IDENTIFICATION

WWDL Name / Code for Storm Water Overflow (chamber) where applicable	Irish Grid Ref. (outfall)	Included in Schedule of the WWDL	Significance of the overflow(High / Medium / Low)	Assessed against DoEHLG Criteria	No. of times activated in 2024 (No. of events)	Total volume discharged in 2024 (m3)	Monitoring Status
SW2	219194, 426466	Yes	Low Significance	Meeting Criteria	Unknown	Unknown	Not Monitored
SW3	219289, 426522	Yes	Low Significance	Meeting Criteria	Unknown	Unknown	Not Monitored

The contents presented in this table include the most up to date information available at the time of writing. Any TBC SWO(s) were identified as part of the ongoing National SWO programme and will be updated in subsequent AER(s) once the information is confirmed.

SWO Summary	
How much wastewater discharge by metered SWOs during the year (m3)?	Unknown
Is each SWO identified as not meeting DoEHLG Guidance included in the Programme of Improvements?	No
The SWO Assessment included the requirements of relevant of WWDL schedules?	Yes
Have the EPA been advised of any additional SWOs / changes to Schedule C3 and A4 under Condition 1.7?	Unknown

4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS.

4.2.1 SPECIFIED IMPROVEMENT PROGRAMME SUMMARY

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
D0342-SIP:01	Infiltration programme - diversion of storm water from the sewer collection network	С	31/12/2012	Yes	Not Started		
D0342-SIP:02	Installation of storm water storage tank	С	31/12/2017	Yes	Work ongoing on- site		
D0342-SIP:03	Redesign WWTP inlet works for better flow control	С	31/12/2012	Yes	Works Completed		
D0342-SIP:04	Upgrading of Storm Water Overflows to comply with the criteria outlined in the DoECLG 'Procedures and Criteria in relation to Storm Water overflows, 1995'	С	31/12/2017	Yes	Work ongoing on- site		

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
D0342-SIP:05	WWTP expansion and upgrade to provide tertiary treatment	С	31/12/2017	Yes	Work ongoing on- site		

A summary of the status of any other improvements identified by under Condition 5 assessments- is included below.

4.2.2 IMPROVEMENT PROGRAMME SUMMARY

Improvement Identifier	Improvement Description / or any Operational Improvements	Improvement Source	Expected Completion Date	Comments
No additional improve	ments planned at this time.			

4.2.3 SEWER INTEGRITY RISK ASSESSMENT

The utilisation of multiple capital maintenance programmes and the outputs of the workshops with the Local Authority Operations Staff held under the programme can be used to satisfy the requirements of Condition 5 regarding network integrity. Improvement works identified by way of these programmes and workshops will be included in the Improvements Summary Tables 4.2.1 and 4.2.2.

5 LICENCE SPECIFIC REPORTS

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Licence Specific Report	Required by licence	Included in this AER
D0342-01-Priority Substances Assessment	Yes	No
D0342-01-Small Stream Risk Score Assessment	Yes	Yes

6 CERTIFICATION AND SIGN OFF

6.1 SUMMARY OF AER CONTENTS

Parameter	Answer
Does the AER include an Executive Summary?	Yes
Does the AER include an assessment of the performance of the Waste Water Works (i.e. have the results of assessments been interpreted against WWDL requirements and or Environmental Quality Standards)?	Yes
Is there a need to advise the EPA for Consideration of a Technical Amendment/Review of the Licence?	N/A
List reason e.g. additional SWO identified	N/A
Is there a need to request/advise the EPA of any modification to the existing WWDL with respect to condition 4 changes to monitoring location, frequency etc	N/A
List reason e.g. changes to monitoring requirements	N/A
Have these processes commenced?	N/A
Are all outstanding reports and assessments from previous AERs included as an appendix to this AER	Yes

I certify that the information given in this Annual Environmental Report is truthful, accurate and complete:

Signed: Date: 26/03/2025

This AER has been produced by Uisce Éireann's Environmental Information System (EIMS) and has been electronically signed off in that system for and on behalf of ,

Eleanor Roche

Head of Environmental Regulation.

7 APPENDIX

Appendix


Appendix 7.1 - Small Stream Risk Score Assessment

River: Mago	us Ran	Gode:	Date: 10/65/74	Time: /(: 5	0
Station no. O	3	Location: D/S	Millord	Grid (6 figure):	
		Stream Order:		Stream flow:	
Field Ch	nemistry	Modifications: Y/N (analised-widened-bank erosion	Riffle Riffle/Glide	
0%	58.7	acterial drainage		Slowiflow	and the same of th
O mg/l	5.62	Dominant Types:	THE STATE OF THE PROPERTY OF THE PROPERTY OF THE STATE OF	Control of the Contro	
emp (°C)	16.6	Bedrock Boulder (>128mm)		The second second section of the second seco	
onductivity	318	Cobble (32-128mm)			
	7.70	Gravel (8-32mm)			
ank width (cm)	100	Fine Gravel (2-8mm)			
et width (cm)	100	Sand (0.25-2mm) Silt (<0.25mm)			
rg Depth (cm)	60	Slope:(Low) - Medium	Male Van Dinh		
aff gauge				Shading: High - Moderat	e – Low - None
Velocity	Colour	Geology: Calcareous-	Siliceous-Mixed		
Torrential	None	1	on: Calcareous-Compacted-	Cattle access Y: upstrear	n - downstream or
Fast	Slight	Loose - Normal			
Moderate	Moderate	Stoney bottom Muddy	bottom-Mud over stones	Manage V (A)	
Very slow	111911		Clean-Slight-Moderate (Heavy)	Photo: Y / N	
Clarity	Discharge	1			
Very dear	Flood		<1 m: 1-5cm, 5-10cm; >10c	m	
Clear	Normal	Litter: None Presen	Moderate - Abundant		
Climbally by talked	l and	Filamentous Algae:		Sewage Eungus:	
Slightly turbid	-OM	None - Present - Mod	derate - Abuncant	None - Presery - Moderat	e - Abundant
lighty turbid	Very Low	Main land use u/s:	Sample	Sampled in Minutes:	A
+ = To	Dry Recent Flood	Pasture Bog	Urban retained: Tillage Y / N	Port het x X3 3mc	nuls
	NGCEIR FIOOD	Forestry	Other	Stone wasn x x6	
				Weed sweep x	
The macroinverteh	orates are divided into	Macroinvertebra the following 5 specific			Relative Abundance
			be damaged during sampling		1-5
		note that tails may be d	lamaged during sampling		6-20
	Trichoptera	, Oliquenaeta and Dipter.	le		21-50
Group 5 =		, Ongothaeta and Dipter	na)		51-100 101-
Calculate t	he total number of ta	exa eno relative abundan	ce of each macromyertebrate g	rous below: (Abundance - Ab)	101
Ephemeroptera:		Ecayonurus Ab	Plecoptera:		Leuctra An
		Rhithrogena Ab			Isoperia Ab
		Heptagenia Ab		Pro	tonemura Ab
		Epnemeraila Ab	winds-40400		hinemura Ab
		Caenis Ab	- 12 To - 12 T	711 2	Perie Ab
	/3			Andrew House, and the same	
		lar aleptophlebla Ab	211		Dinocras Ab
	Εļ	phemera danica Ab		Oth	er Plecop Ao
		Other Ephem Au		Oth	er Plecop Ab
Total no. of ta	ixa Total R	elative Abundance	Total no. of Taxa	Total Relative	Abundance
Trichoptera:	Hydropsychic	dae Ab G.OL.D:	Lymnaea (G) Ab	Chironomidae (D) Abi	Asellus.
	Polycentropodio	dae Ab	Petamepyrgus (G) Ab	Chiranomus (D) Ab	Absent
	Rhyacop	hila Ab	Plancibis (G) Ab 1	Simuliidae (D) Ab	.Few/Low
	Philopotamic		Ancylus (G) Ab	Dicranota (D) Ab 3	Common/
	Limnephili	dae Ab	Physa (G) Ab	Tipulidae (D) Ab	Numerous \
	Sericostomatic	dae Ab	Lumpriculus (OI) Ab	Caratopogonidae (D) Ab	1000
	Glossosomatic	THE REAL PROPERTY AND ADDRESS OF THE PARTY AND	Eiseniella (OI) Ab	Other GOLD Ab	NOTE: Asallus must be
	Lepidostomatic		Tubificidae (OI) Ab 3		recorded as
	Other Trichopte			Transfer or the transfer of th	absent if none
Total no. o		lelative	Total no. of Taxa 2	Total Relative Abundance	z are found
Tax	a Abu	ndance	7	1	


NOTE Baetis is an Ephemeropteran and is the most commonly occurring invertebrate genus in streams in Ireland. It is vital that Baetis is not counted in SSRS. See Appendix B for more details on how to identify Baetis.

u/S Milford River: Maggies Burn Con Time: 11:00 Date: 10/5/24 Location: U/s Milford Station no. Grid (6 figure); Stream Order: Stream flow: Field Chemistry Modifications Y (Canalised Widened-bank erosion Riffle/Glide DO% acterial draining Dominant Types DO mg/l 9.31 Bedrock Boulder > 128mm) Conde (32-128mm) Gravel (8-37mm) Temp (°C) Conductivity 8 13 pH Fine Gravel (2-8mm) Sand (0.25-2mm) Bank width (cm) 200 Wet width (cm) 200 Silt (<0.25mm) Avg Depth (cm) Stope (Lov) - Medium - High - Very High Staff gauge Geology: Calcargous Siliceous Mixed Shading: High (Moderate) Low None Velocity Colour **Torrential** Substratum Condition Calcareous Compacted None Cattle access Y: Upstream - downstream of N Fast Slight Loose - Norma Moderate Substratum: (Modérate) Stoney bottom-Muddy bottom Mud over stones Slow High Photo: Y / N Very slob Degree of slitation: Clean-Sight Moderate Heavy Discharge Clarity Depth of mud: None: <1cm (1-5cm) 5-10cm: >10cm Very dear Flood Clear Litter: None Present Moderate - Abundant Normal Filamentous Algae: None Present Moderate Aduncant Slightly turbed Low Sewage Fungus: None - Present - Moderate - Abundant Highly turbid Very Low Main land use u/s: Sampled in Minutes: Sample Dry **Pasture** JIDEO retained: Pond net x 3 Recent Flood Bog Image Stone wash x Forestry Other Viees sweep x **General Comments: Macroinvertebrate Composition** Relative The macroinvertebrates are divided into the following S specific groups: **Abundance** Group 1 = Ephemeroptera (3-tails) - note that tails may be damaged during sampling 1-5 Group 2 = Plecoptera (2-talls) - note that talls may be damaged during sampling 6-20 Group 3 = Trichoptera 21-50 Group 4 = G.OL.D (Gastropoda, Oligochaeta and Diptera) 51-100 Group 5 = Asellus 101-Calculate the total number of taxa and relative abundance of each macroinvertebrate group below. (Abundance - Ab) Ephemeroptera: Ecayonurus Ab Plecoptera: Leuctra Ab Rhithrogena Ab Isoperia Ab Heptagenia Ab Protonemura Ab Ephemerella Ab Amphinemura Ab Caenis Ab Panla Ab Paraleptophlebia Ab Dinocras Ab Ephemera danica Ab Other Plecap Ab Other Ephern Ab Other Pleasp Ab Total no. of taxa Total Relative Abundance Total no, of Taxa Total Relative Abundance Trichoptera: G.OLD: Hydropsychidae Ab Lymnaea (G) Ab Chironomidae (D) Ab Polycentropodidae Ab Petamopyrgus (G) Ab Chironomus (D) Ab Rhyacophila Ab Planorbis (G) Ab Simulidae (D) Ab 3 Few/Low Philopotamidae Ab Aricylus (G) Ab Dioranota (D) Ab Common Limnephilidae Ab Numerous Physa (G) Ab Tipulidae (D) Ab Sericostomatidae Ab Lumbriculus (OI) Ab Ceratopogenidae (D) Ab Glossosomatidae Ab NOTE: Asellus Eiseniella (OI) Ab Other GOLD must be Lepidostomatidae Ab Tublficidae (OI) Ab recorded as Other Trichoptera Ab absent if none Total no. of **Total Relative** re found Total no. of Taxa Total Relative Abundance Abundance Taxa


NOTE Baetis is an Ephemeropteran and is the most commonly occurring invertebrate genus in streams in Ireland. It is vital that Baetis is not counted in SSRS. See Appendix B for more details on how to identify Baetis.

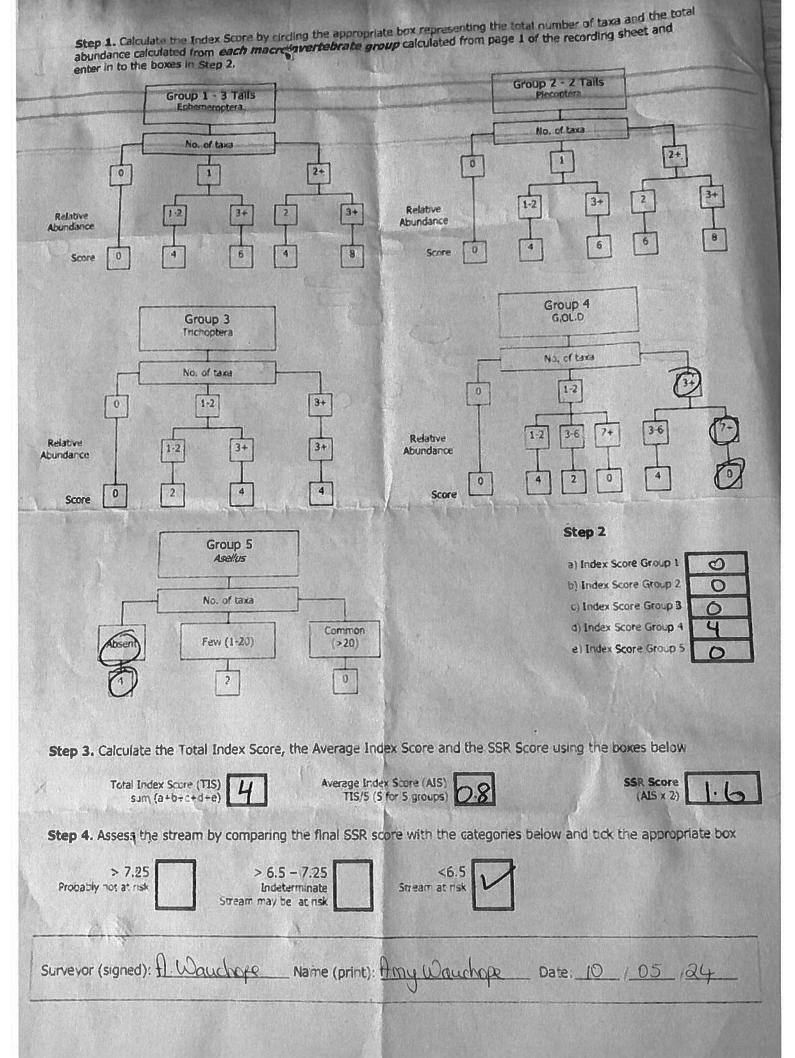


Step 1. Calculate the Index Score by circling the appropriate box representing the total number of taxa and the fotal abundance calculated from **each macroinvertebrate group** calculated from page 1 of the recording sheet and enter in to the boxes in Step 2.

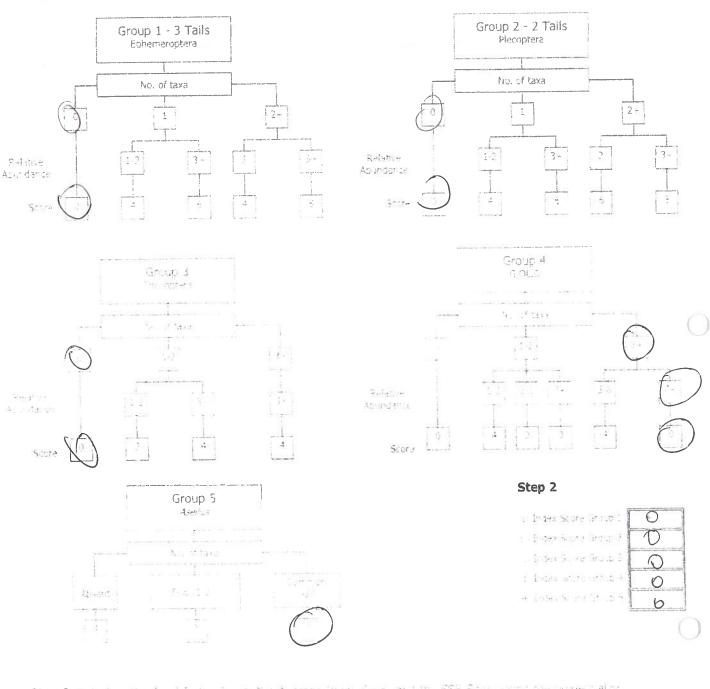

Step 3. Calculate the foral Index Source for Average Index Source and the SSR Source raing the united tellor.

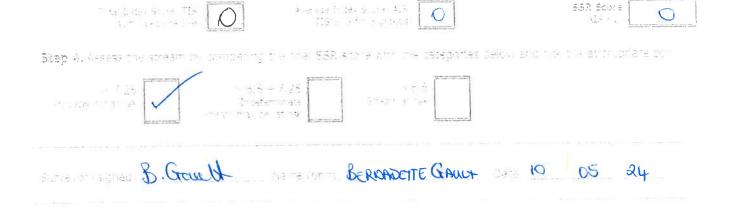

Step 1. Calculate the Index Scora by circling the appropriate box representing the total number of taxa and the total abundance calculated from each macroinvertabrate group calculated from page 1 of the recording sheet and enter in to the boxes in Step 2.

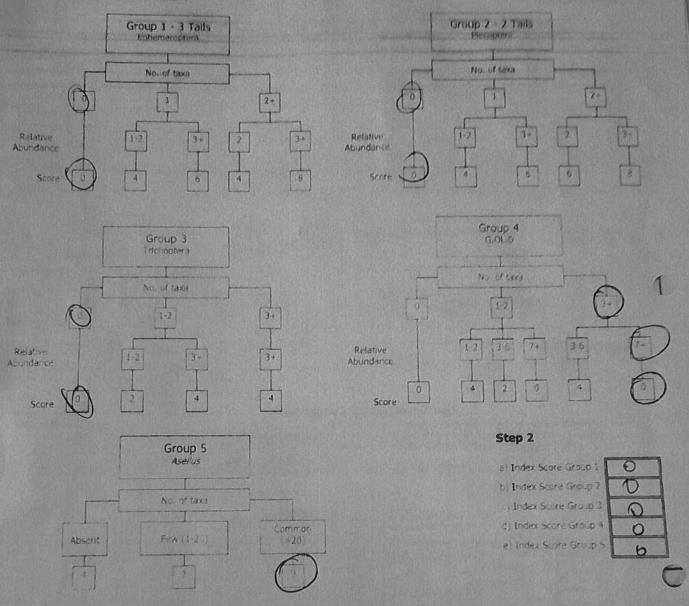

Step 3, Calculate the Total Index Score, the Average Index Score and the SSR Score using the boxes below

Total Index Score (TIS)

Average Index Store (AIS)

SSR Score

	1	7		
> /.25 /	> 5,5 - 7.25 Indeterminate Smear may be at risk	Stream at risk		
	Stream may be at risk		EB STATE	